



# SPECIFICATIONS FOR CAMP OR COOKING FIRES (CATEGORY I)

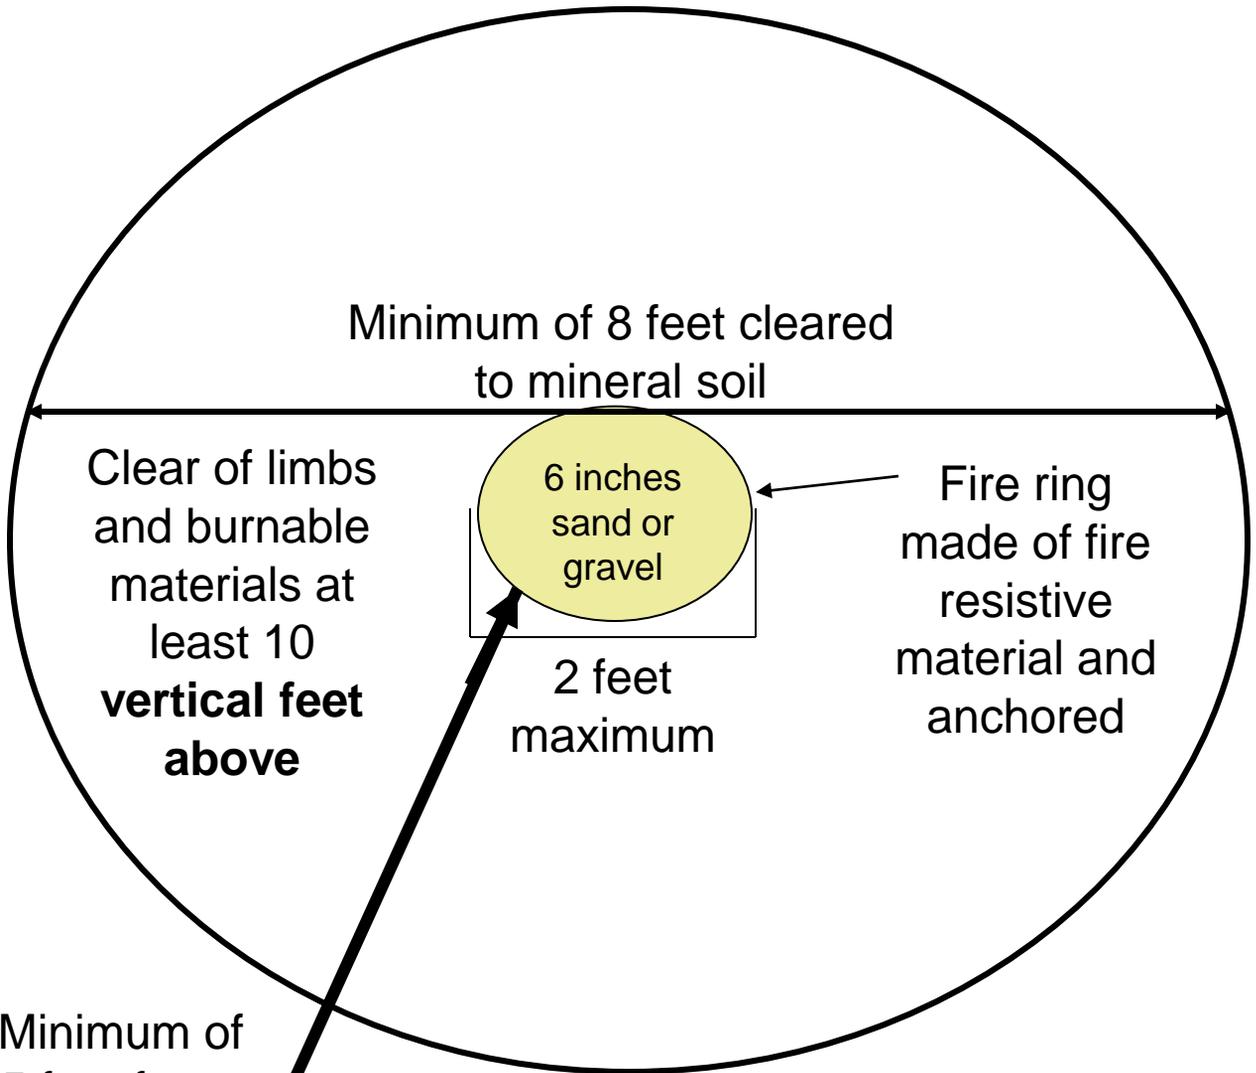


Minimum of 25 feet from a structure

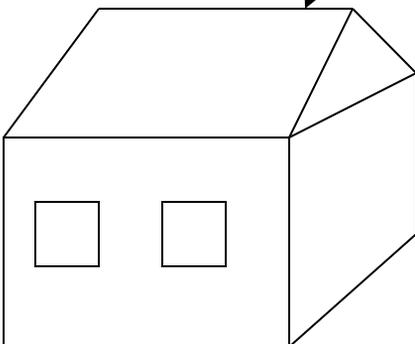


**Only clean, untreated wood, no greater than 5 inches in diameter can be burned**

# SPECIFICATIONS FOR CAMP OR COOKING FIRES (CATEGORY II)

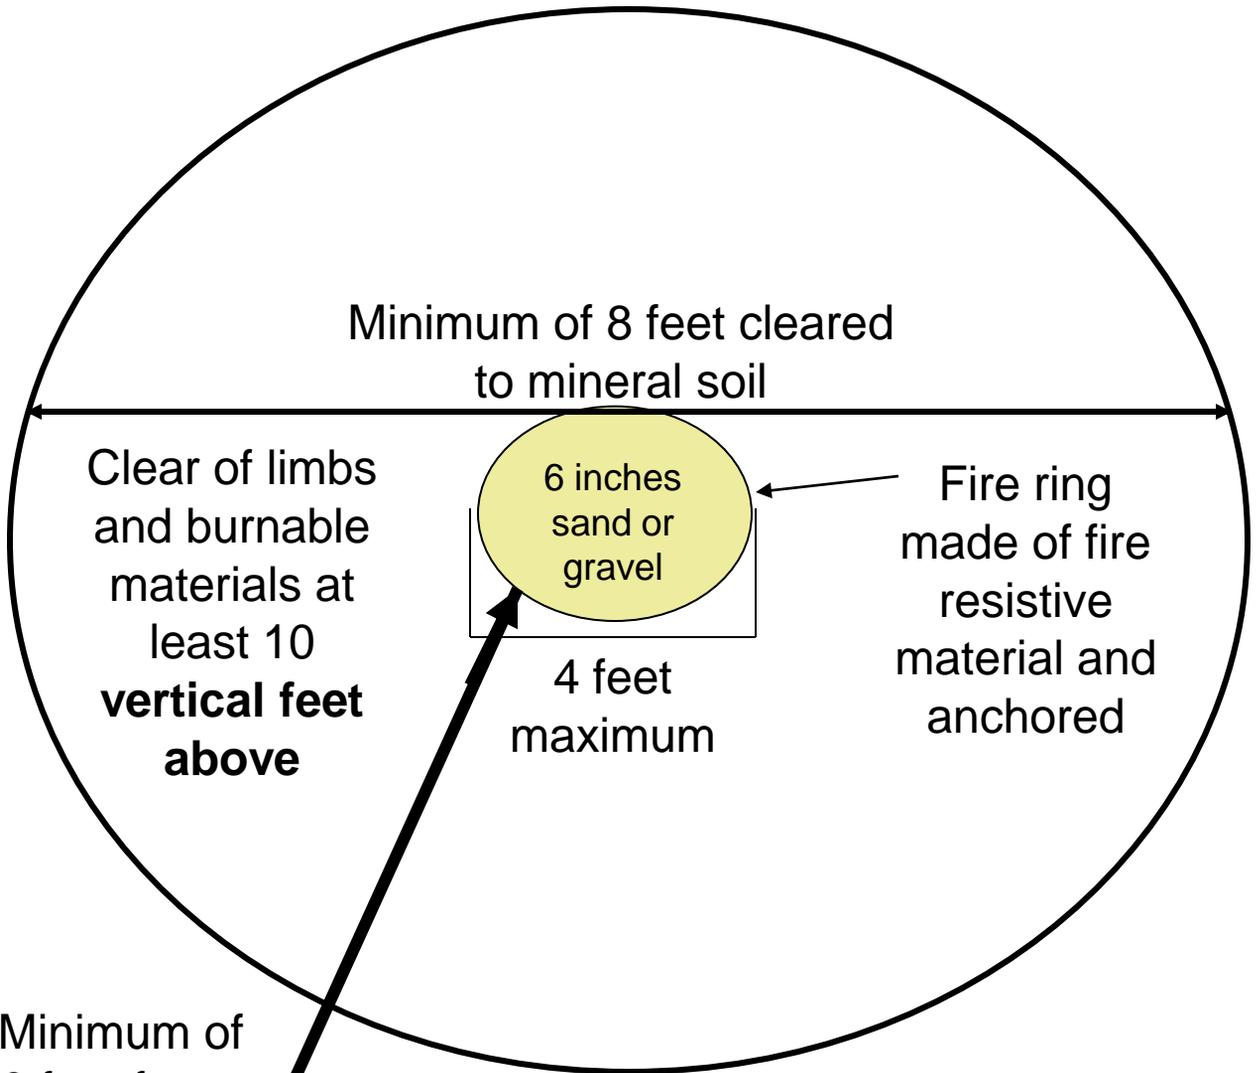

Minimum of 50 feet from a structure

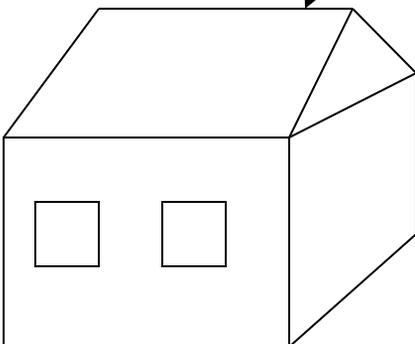

**Only clean, untreated wood, no greater than 5 inches in diameter can be burned**